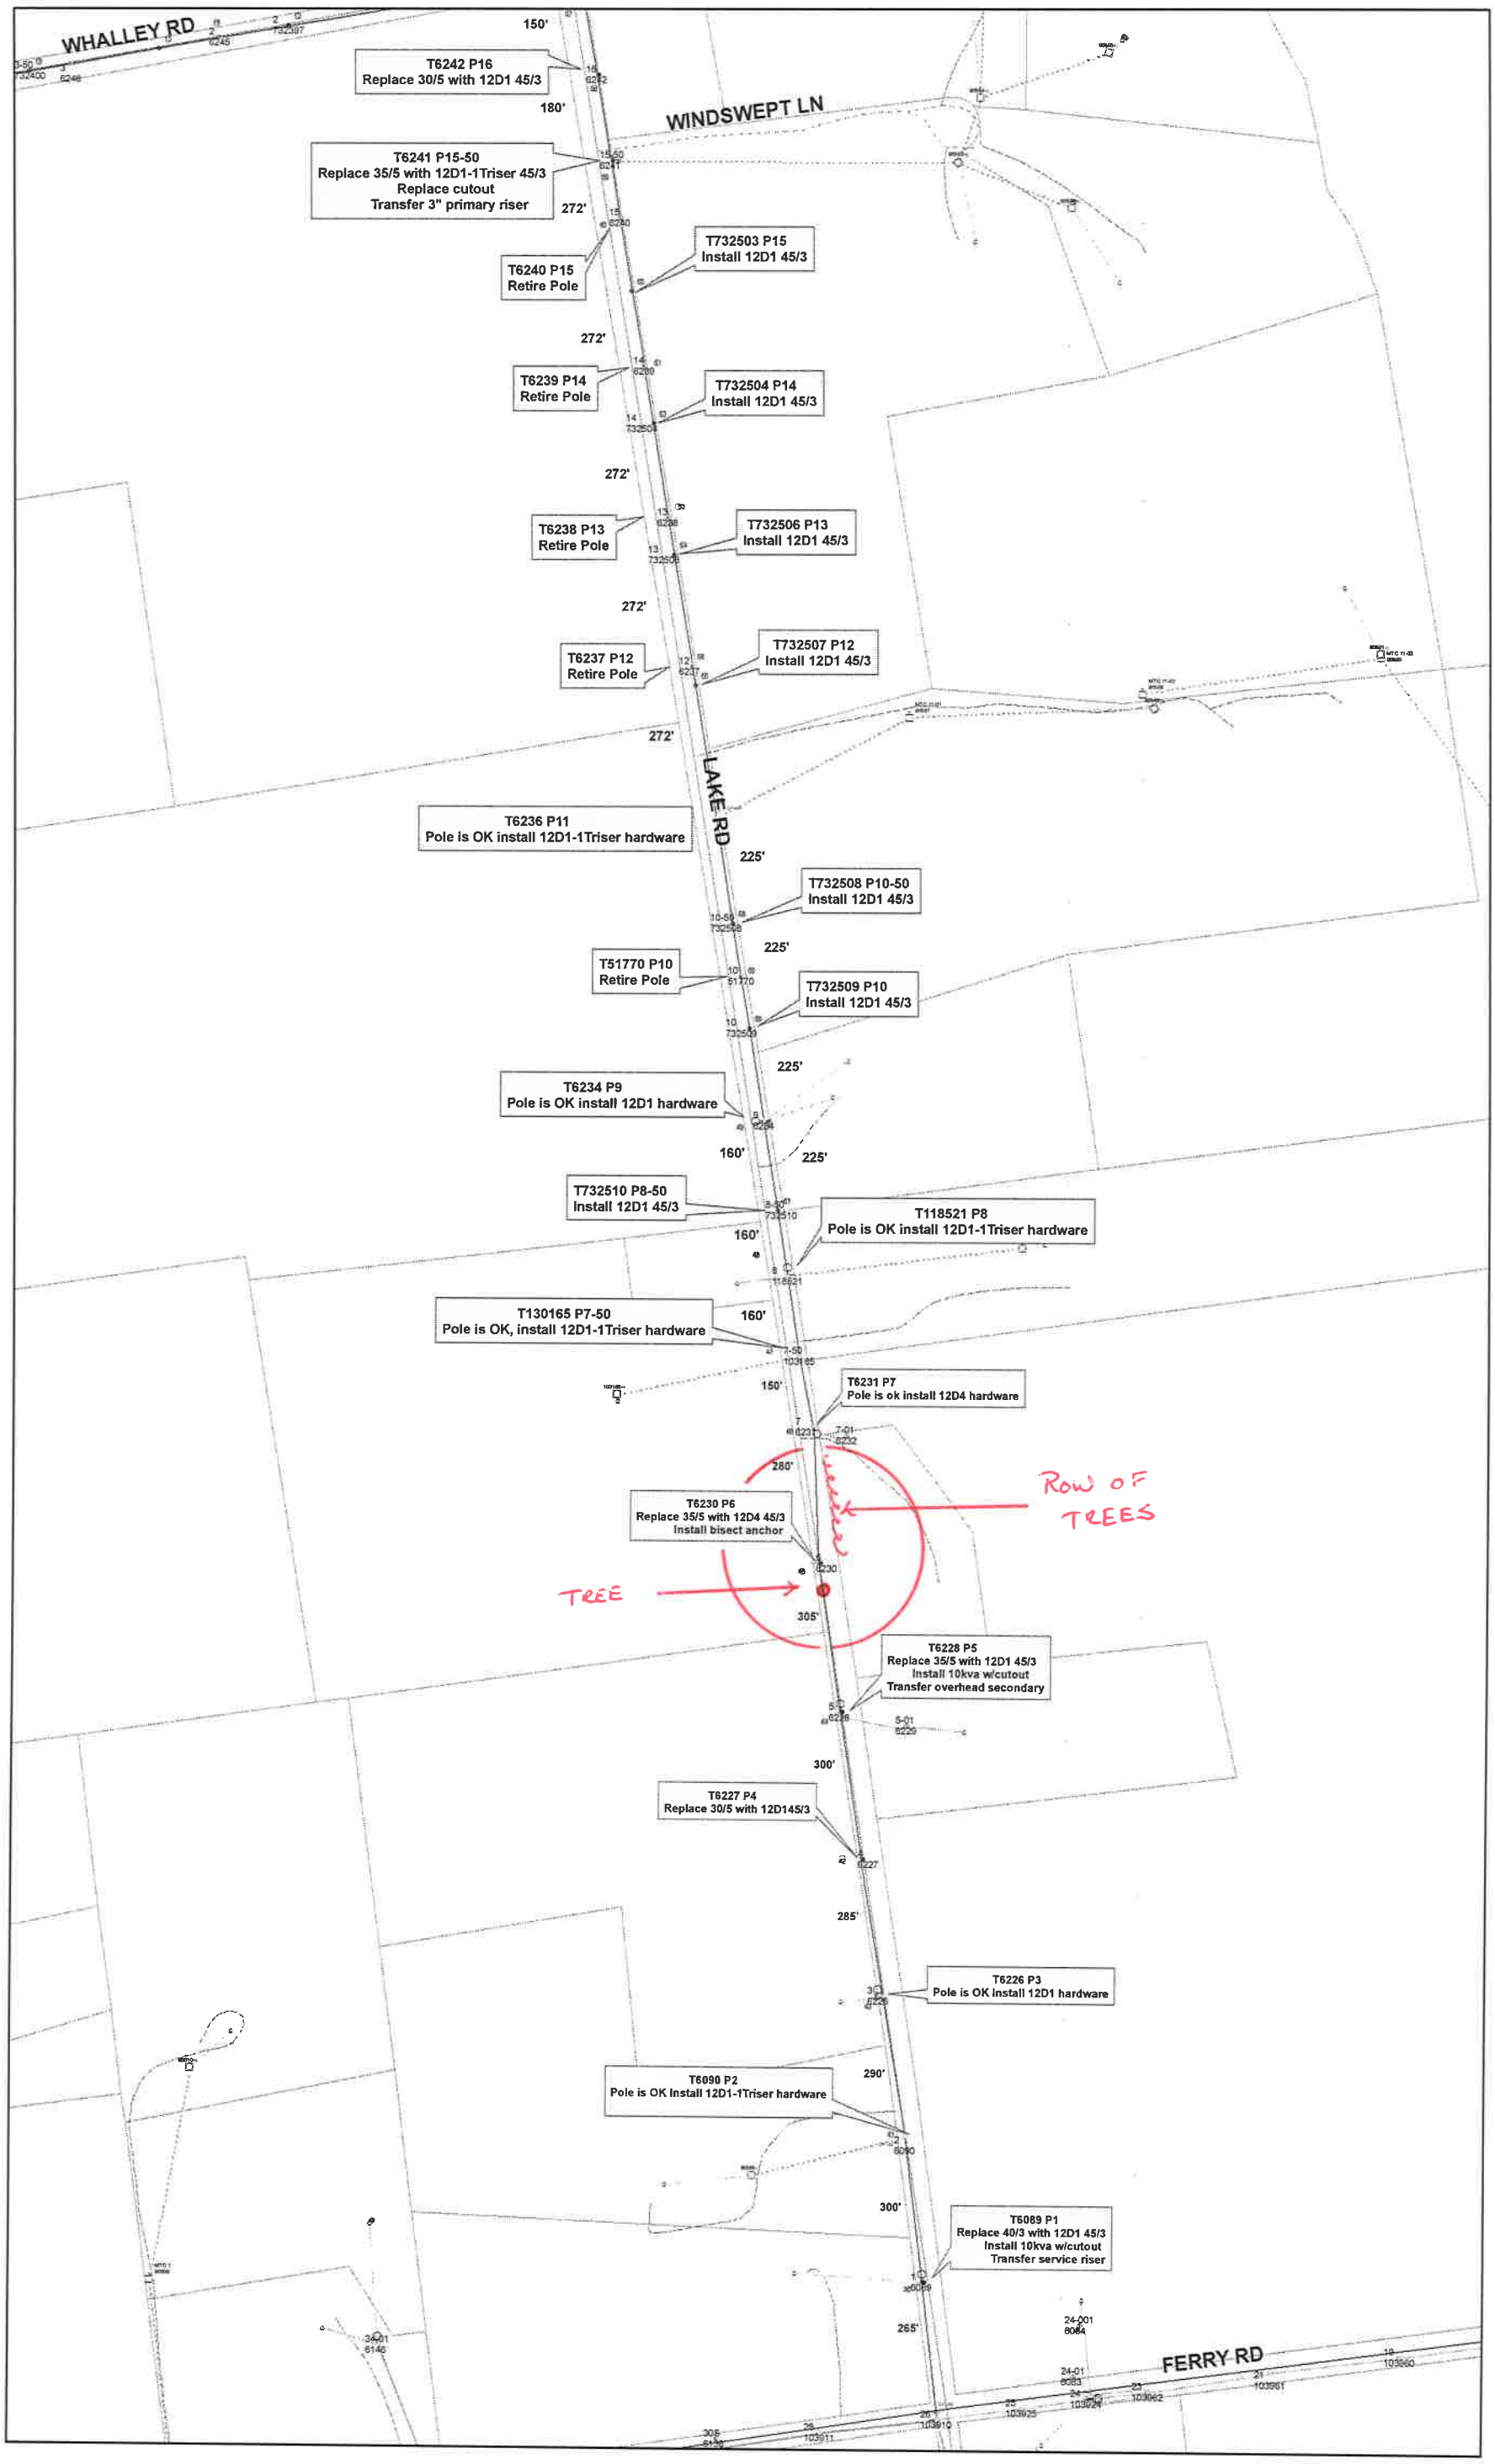
WHALLEY RD
WINDSWEPT LN
LAKE RD
FERRY RD
150'
T6242 P16
Replace 30/5 with 12D1 45/3
180'
T6241 P15-50
Replace 35/5 with 12D1-1Triser 45/3
Replace cutout
Transfer 3" primary riser
272'
T6240 P15
Retire Pole
T732503 P15
Install 12D1 45/3
272'
T6239 P14
Retire Pole
T732504 P14
Install 12D1 45/3
272'
T6238 P13
Retire Pole
T732506 P13
Install 12D1 45/3
272'
T6237 P12
Retire Pole
T732507 P12
Install 12D1 45/3
272'
T6236 P11
Pole is OK install 12D1-1Triser hardware
225'
T732508 P10-50
Install 12D1 45/3
225'
T51770 P10
Retire Pole
T732509 P10
Install 12D1 45/3
225'
T6234 P9
Pole is OK install 12D1 hardware
160'
225'
T732510 P8-50
Install 12D1 45/3
T118521 P8
Pole is OK install 12D1-1Triser hardware
160'
T130165 P7-50
Pole is OK, install 12D1-1Triser hardware
160'
150'
T6231 P7
Pole is ok install 12D4 hardware
280'
ROW OF TREES
T6230 P6
Replace 35/5 with 12D4 45/3
Install bisect anchor
TREE
305'
T6228 P5
Replace 35/5 with 12D1 45/3
Install 10kva w/cutout
Transfer overhead secondary
300'
T6227 P4
Replace 30/5 with 12D145/3
285'
T6226 P3
Pole is OK install 12D1 hardware
290'
T6090 P2
Pole is OK Install 12D1-1Triser hardware
300'
T6089 P1
Replace 40/3 with 12D1 45/3
Install 10kva w/cutout
Transfer service riser
265'

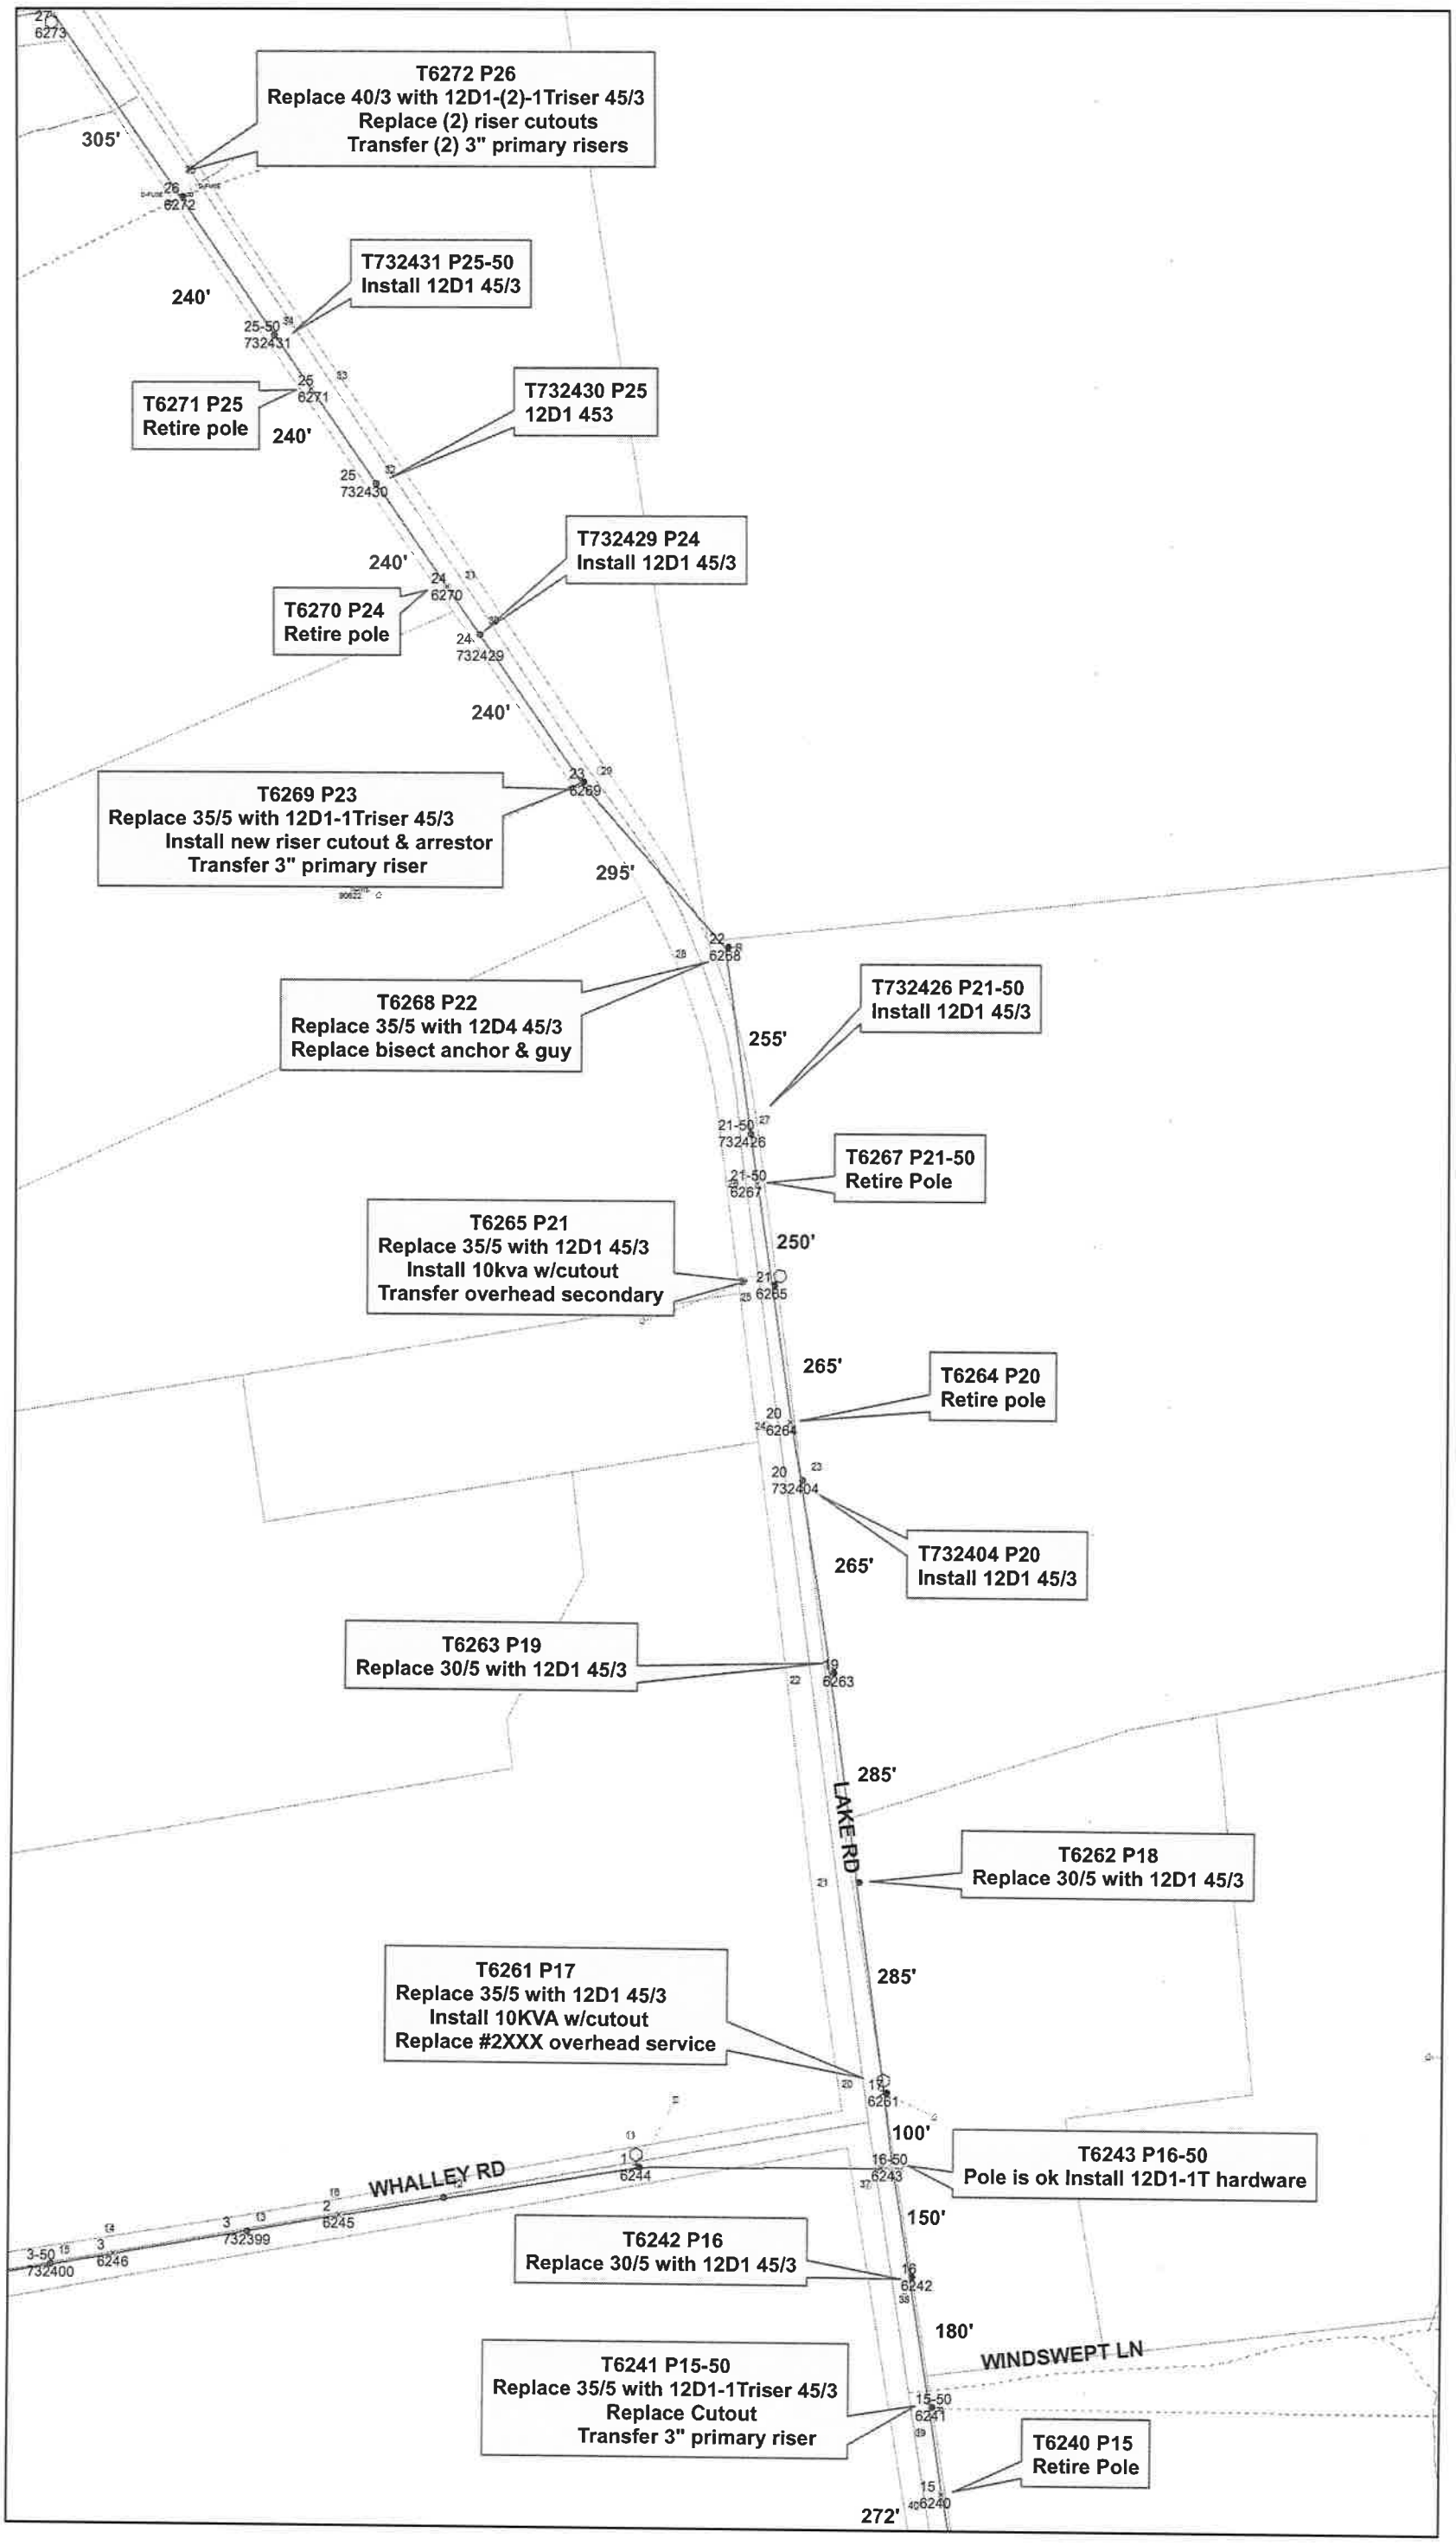
T6272 P26
Replace 40/3 with 12D1-(2)-1Triser 45/3
Replace (2) riser cutouts
Transfer (2) 3" primary risers
305'
T732431 P25-50
Install 12D1 45/3
240'
T6271 P25
Retire pole
240'
T732430 P25
12D1 453
240'
T732429 P24
Install 12D1 45/3
T6270 P24
Retire pole
240'
T6269 P23
Replace 35/5 with 12D1-1Triser 45/3
Install new riser cutout & arrestor
Transfer 3" primary riser
295'
T6268 P22
Replace 35/5 with 12D4 45/3
Replace bisect anchor & guy
255'
T732426 P21-50
Install 12D1 45/3
T6267 P21-50
Retire Pole
T6265 P21
Replace 35/5 with 12D1 45/3
Install 10kva w/cutout
Transfer overhead secondary
250'
265'
T6264 P20
Retire pole
265'
T732404 P20
Install 12D1 45/3
T6263 P19
Replace 30/5 with 12D1 45/3
285'
LAKE RD
T6262 P18
Replace 30/5 with 12D1 45/3
285'
T6261 P17
Replace 35/5 with 12D1 45/3
Install 10KVA w/cutout
Replace #2XXX overhead service
100'
T6243 P16-50
Pole is ok Install 12D1-1T hardware
WHALLEY RD
150'
T6242 P16
Replace 30/5 with 12D1 45/3
180'
WINDSWEPT LN
T6241 P15-50
Replace 35/5 with 12D1-1Triser 45/3
Replace Cutout
Transfer 3" primary riser
T6240 P15
Retire Pole
272'

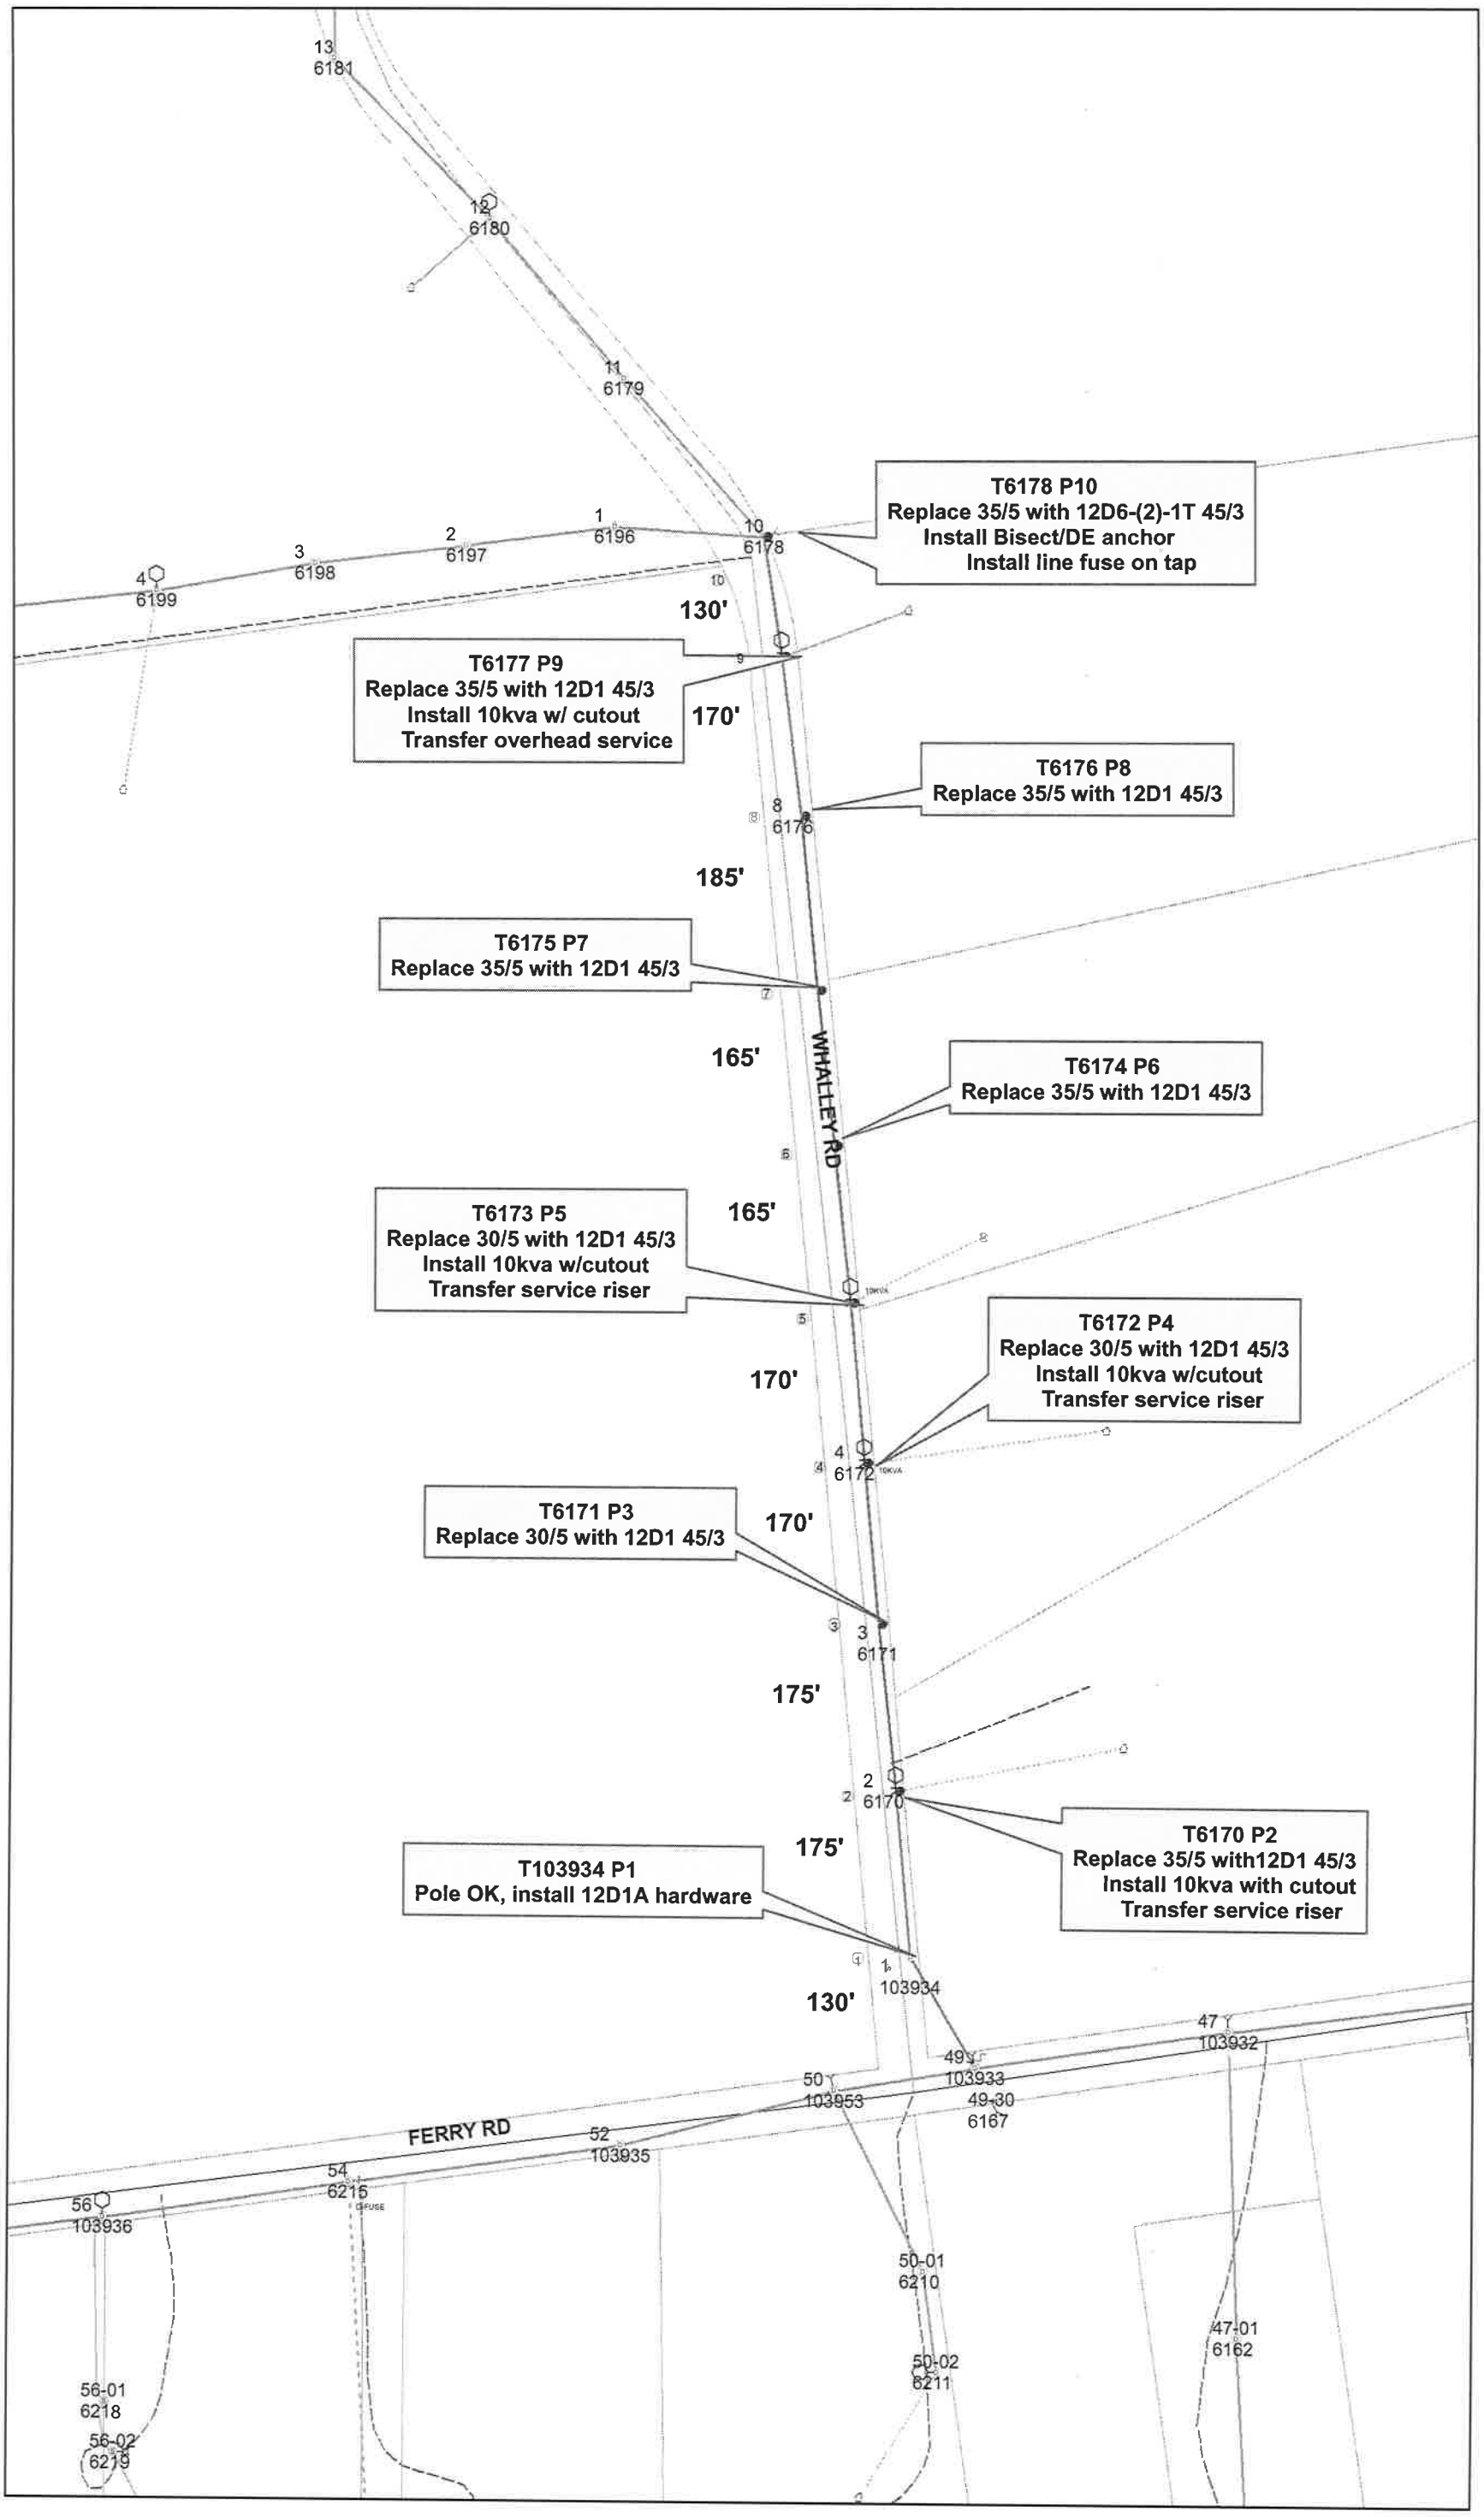
13
6181
12
6180
11
6179
T6178 P10
Replace 35/5 with 12D6-(2)-1T 45/3
Install Bisect/DE anchor
Install line fuse on tap
1
6196
2
6197
3
6198
4
6199
10
6178
130'
T6177 P9
Replace 35/5 with 12D1 45/3
Install 10kva w/ cutout
Transfer overhead service
170'
T6176 P8
Replace 35/5 with 12D1 45/3
8
6176
185'
T6175 P7
Replace 35/5 with 12D1 45/3
165'
WHALLEY RD
T6174 P6
Replace 35/5 with 12D1 45/3
T6173 P5
Replace 30/5 with 12D1 45/3
Install 10kva w/cutout
Transfer service riser
165'
T6172 P4
Replace 30/5 with 12D1 45/3
Install 10kva w/cutout
Transfer service riser
170'
4
6172
T6171 P3
Replace 30/5 with 12D1 45/3
170'
3
6171
175'
2
6170
T6170 P2
Replace 35/5 with12D1 45/3
Install 10kva with cutout
Transfer service riser
175'
T103934 P1
Pole OK, install 12D1A hardware
1
103934
130'
47
103932
49
103933
49-30
6167
50
103953
FERRY RD
52
103935
54
6216
56
103936
50-01
6210
47-01
6162
50-02
6211
56-01
6218
56-02
6219

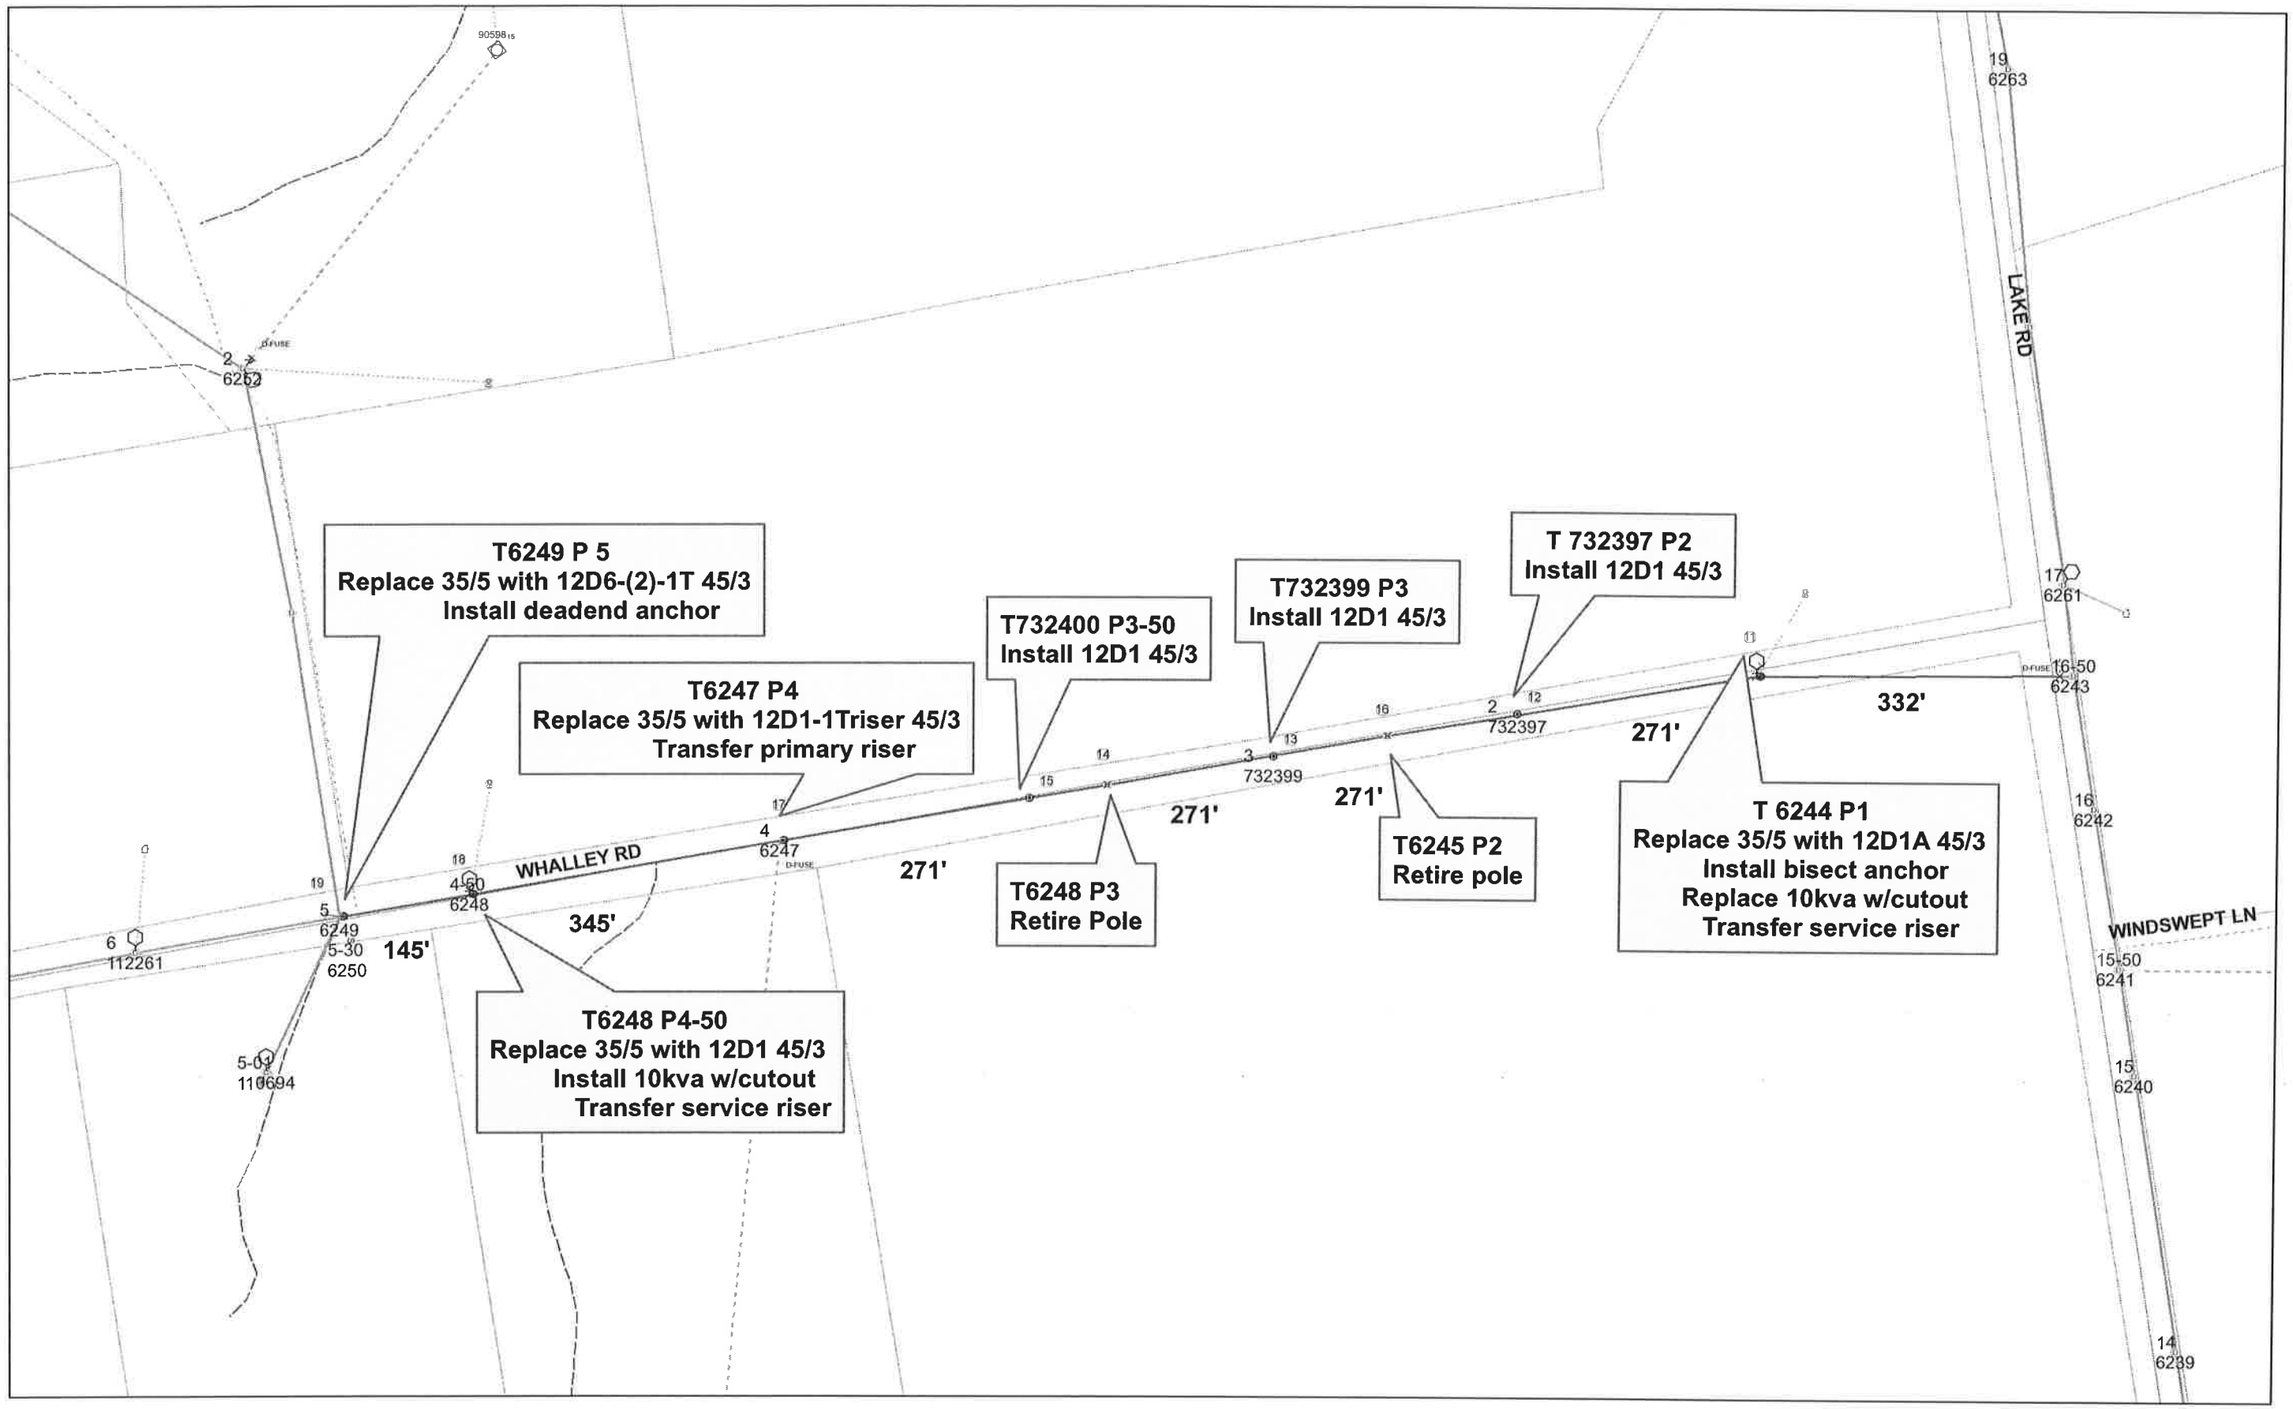
T6249 P 5
Replace 35/5 with 12D6-(2)-1T 45/3
Install deadend anchor
T6247 P4
Replace 35/5 with 12D1-1Triser 45/3
Transfer primary riser
T732400 P3-50
Install 12D1 45/3
T732399 P3
Install 12D1 45/3
T 732397 P2
Install 12D1 45/3
T6248 P3
Retire Pole
T6245 P2
Retire pole
T 6244 P1
Replace 35/5 with 12D1A 45/3
Install bisect anchor
Replace 10kva w/cutout
Transfer service riser
T6248 P4-50
Replace 35/5 with 12D1 45/3
Install 10kva w/cutout
Transfer service riser
WHALLEY RD
LAKE RD
WINDSWEPT LN
145'
345'
271'
271'
271'
271'
332'
2
6252
19
6263
17
6261
16-50
6243
16
6242
15-50
6241
15
6240
14
6239
5
6249
5-30
6250
4-50
6248
4
6247
3
732399
2
732397
6
112261
5-01
110694