



5-OUTLET D-BOX

N.T.S.

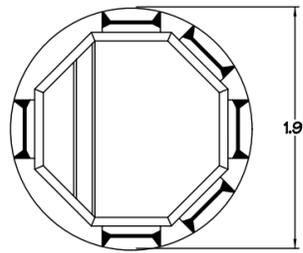



Plan

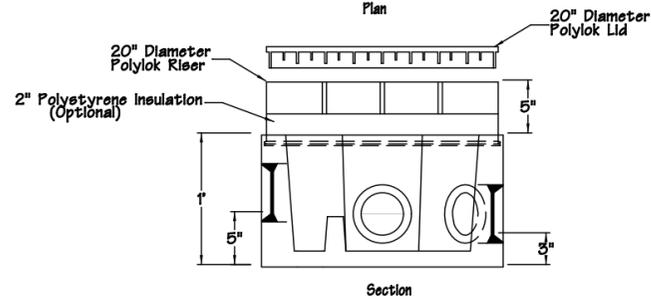

Section

TRENCH DETAIL

N.T.S.

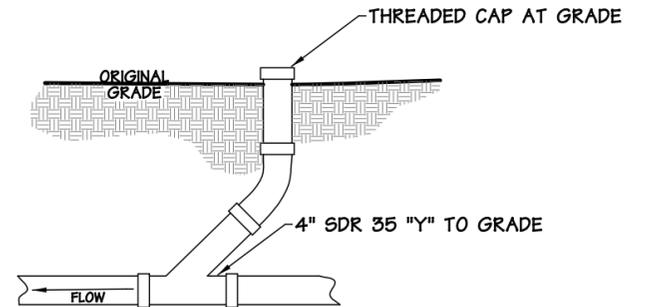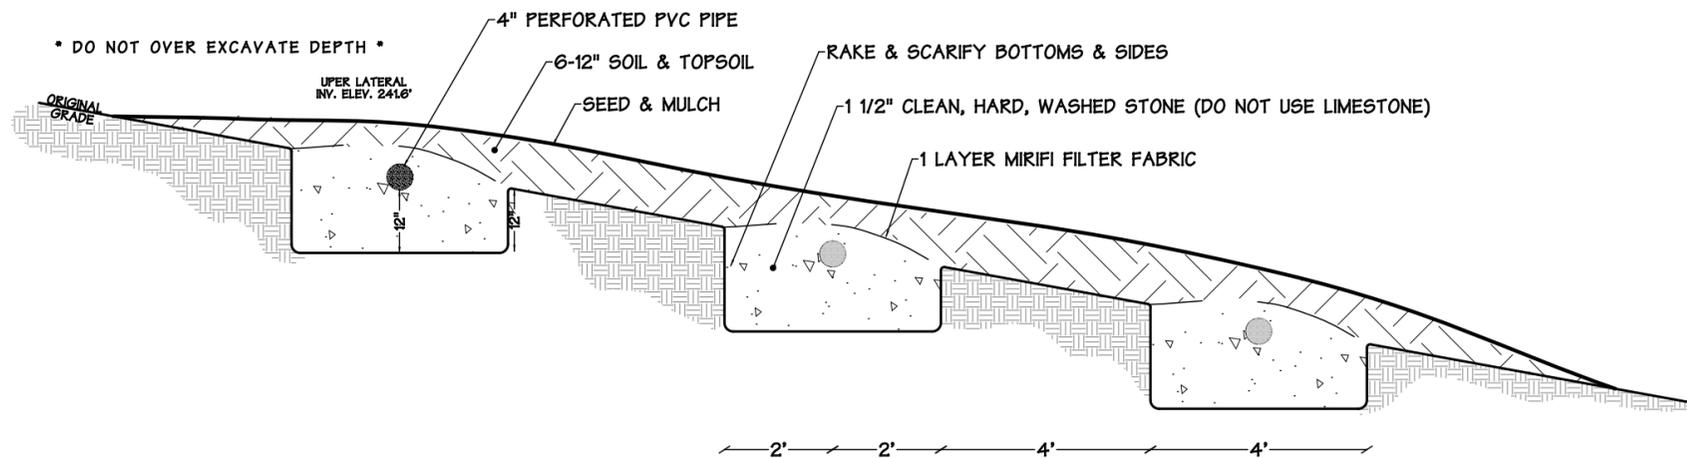

CLEANOUT DETAIL


N.T.S.

CONSTRUCTION NOTES

- 1) CONTACT THE TECHNICIAN OR ENGINEER PRIOR TO INSTALLATION TO REVIEW AND STAKE OUT THE SYSTEM.
- 2) DIG DOWN 12" ON THE LOWER SIDE OF THE DISPOSAL TRENCHES AND LEVEL BACK FROM THERE. *****DO NOT OVERDIG DEPTH*****
- 3) RAKE THE BOTTOMS AND SIDES TO REMOVE ANY SOIL SMEARING.
- 4) PLACE 12" OF 1 1/2" CRUSHED OR GRADED STONE IN THE TRENCHES. THE STONE MUST BE CLEAN AND HARD. DO NOT USE LIMESTONE
- 5) LAY 4" PERFORATED PVC PIPE LEVEL AS SHOWN. MAKE SURE END CAPS & COUPLINGS ARE GLUED IN PLACE.
- 6) CONTACT VERMONT CONTOURS INC. (453-2351) 48 HOURS PRIOR TO COVERING THE SYSTEM
- 7) PLACE 6" OF STONE AROUND AND OVER THE PIPE.
- 8) PLACE A MATTING OF MIRAFI OR EQUIVALENT FILTER FABRIC OVER THE ENTIRE STONE.
- 9) COVER WITH 6-12" OF SOIL AND TOPSOIL. GRADE THE AREA TO PREVENT ANY SURFACE WATER FROM PONDING ON THE SYSTEM.
- 10) SEED AND MULCH THE ENTIRE AREA.

NOTES:


- PARCEL INFORMATION OBTAINED FROM TOWN TAX MAPS & INFORMATION FOUND IN THE FIELD. THIS IS NOT A SURVEY.
- THIS PLAN IS INTENDED FOR SEPTIC PERMITTING ONLY AND NO OTHER USE IS PERMITTED
- PRIOR TO ANY CONSTRUCTION ON THE PARCEL, A SITE VISIT SHALL TAKE PLACE WITH THE OWNER, CONTRACTOR & DESIGNER TO DISCUSS & VERIFY SYSTEM & WELL LOCATIONS
- 2' CONTOUR INFORMATION OBTAINED FROM JAVAD RTK GNSS RECEIVER & VCGI LIDAR INFORMATION.
- THE DESIGNER HAS DETERMINED A LOCATION FOR WASTEWATER DISPOSAL SYSTEMS ON THE PROPERTY BASED ON A SITE EVALUATION & SOIL TEST PITS.
- THE OWNER OF THE PARCELS IS RESPONSIBLE FOR PROPER OPERATION & MAINTENANCE OF THE PROPOSED SYSTEM TO PROTECT PUBLIC HEALTH & GROUNDWATER
- THE SEPTIC TANKS SHALL BE CHECKED FOR SOLIDS ON A YEARLY BASIS & PUMPED AS NEEDED. THE DISTRIBUTION BOX SHALL ALSO BE CHECKED AT THIS TIME & CLEANED IF NECESSARY
- THE LIFE OF THE SYSTEM CANNOT BE ESTIMATED DUE TO CONDITIONS BEYOND THE CONTROL OF THE DESIGNER SUCH AS EXCESS GROUNDWATER, RAINWATER, & THE INTRODUCTION OF FOREIGN MATERIAL INTO THE SYSTEM
- WATER SAVING DEVICES AND WATER CONSERVATION IS RECOMMENDED
- DUE TO INSTANCES BEYOND THE CONTROL OF THE DESIGNER, THE DESIGNER ASSUMES NO RESPONSIBILITY FOR THE CONTINUED FUNCTIONING AND PROPER USE & MAINTENANCE OF THE SYSTEM
- GARBAGE DISPOSAL ARE NOT RECOMMENDED. IF THEY ARE USED, THE SEPTIC TANK SHALL BE DOUBLED IN SIZE.
- PRIOR TO CONSTRUCTION THE OWNERS SHALL REVIEW THE PLANS & CONTACT THE DESIGNER WITH ANY QUESTIONS REGARDING THE PLANS. MODIFICATIONS TO THE DESIGN OR CONSTRUCTION PROCEDURES MAY LEAD TO SYSTEM FAILURE WITH NO RESPONSIBILITY OF THE DESIGNER
- THIS PLAN IS INTENDED TO MEET THE CURRENT STATE OF VERMONT WASTEWATER RULES.
- THIS PLAN IS INTENDED FOR WASTEWATER PERMITTING ONLY, NOT VALID FOR ANY OTHER USE.

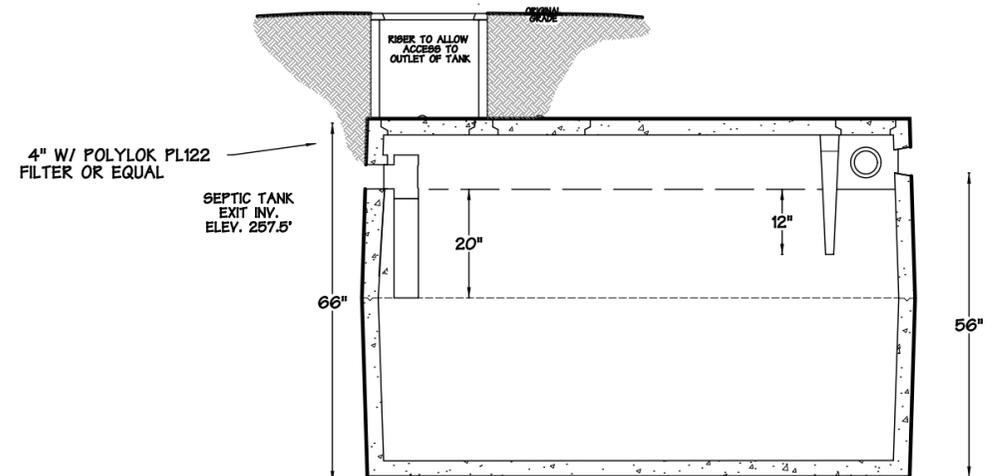

1000 GAL. CONCRETE SEPTIC TANK W/ FILTER

N.T.S.

No.	DATE	DESCRIPTION	BY



DATE

WRIGHT

3046 GREENBUSH RD
CHARLOTTE, VERMONT

DETAILS



SEPTIC SYSTEM DESIGNS
TOPOGRAPHIC SITE PLANS & MAPPING
G.P.S. MAPPING
P.O. BOX 384
BRISTOL, VERMONT 05443
453-2351

Drawn: SKH
Date: 11/30/16
Scale: AS SHOWN
Project: WRIGHT
Sheet: 2 OF 2