


VERMONT WATER SUPPLY RULE — CHAPTER 21
TABLE A — REQUIRED MINIMUM SEPARATION DISTANCES

Potential Source of Contamination and other Siting Limitations	Separation Distance
Roadway, Parking Lot (outer edge of shoulder)	25'
Driveway (less than 3 residences)	15'
Sewage System Disposal Fields	a.
Subsurface Wastewater Piping and Related Tanks	50'
Property Line	10'b
Limit of Herbicide Application on Utility R.O.W.	100'c
Surface Water	10'd
Flood ways	e.
Buildings	10'
Concentrated Livestock Holding Area & Manure Storage Systems	200'
Hazardous or Solid Waste Disposal Site	f.
Non-sewage Wastewater Disposal Fields	f.
a. See Table B	
b. Increased to 50' when adjacent to agricultural cropland.	
c. Applies to rights-of-way (ROW) where herbicides have been applied in the past 12 months or may be applied in the future. This distance may be increased to 200' depending on the active ingredient in the herbicide according to Vermont Regulations for Control of Pesticides.	
d. For Public water sources, see Appendix A, part 3, Subpart 3.3.8.	
e. Water sources shall not be located in a flood way.	
f. If a water source is potentially downgradient of a source of contamination, then the Agency shall apply the criteria in 11.4.2.2.	



SITE ENGINEER:

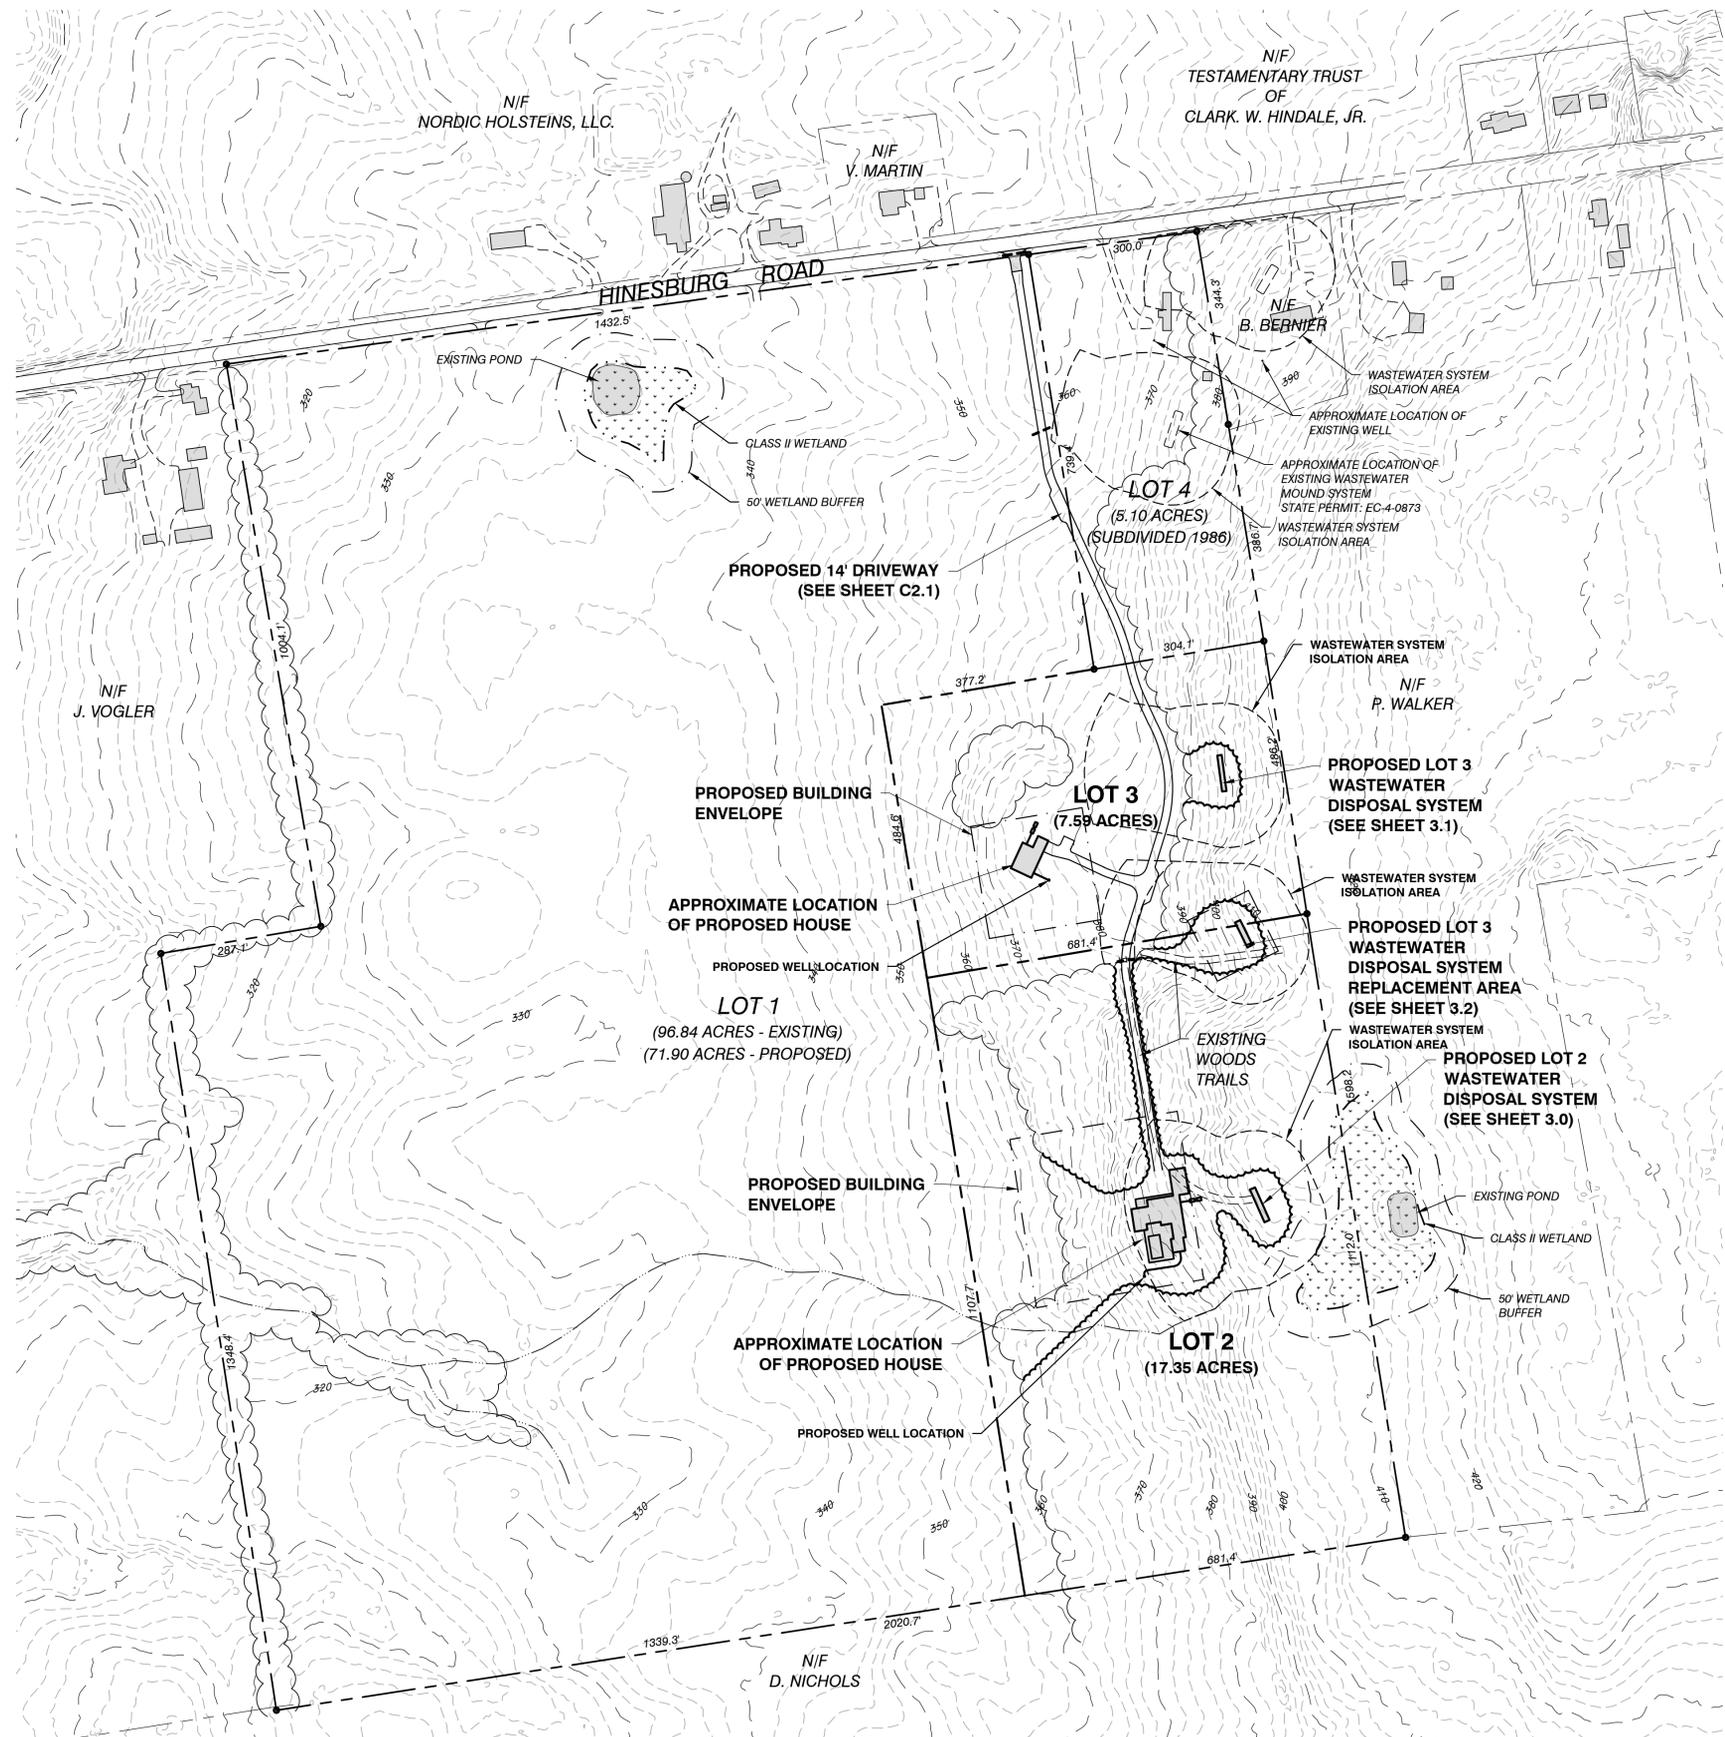


CIVIL ENGINEERING ASSOCIATES, INC.
10 MANSFIELD VIEW LANE, SOUTH BURLINGTON, VT 05403
802-864-2323 FAX: 802-864-2271 web: www.cca-vt.com

COPYRIGHT © 2018 - ALL RIGHTS RESERVED

DRAWN	SAL
CHECKED	DSM
APPROVED	DSM

OWNER:
CLARK W. HINSDALE III
1211 ETHAN ALLEN HIGHWAY
CHARLOTTE, VERMONT

PROJECT:
BEAN FARM
1824 HINESBURG ROAD
CHARLOTTE, VT

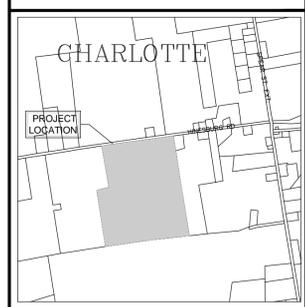


LOCATION MAP
1" = 2000'

DATE	CHECKED	REVISION

**PROPOSED
CONDITIONS
OVERALL SITE
PLAN**

DATE	JAN., 2018	DRAWING NUMBER	C1.1
SCALE	1" = 150'		
PROJ. NO.	17218		

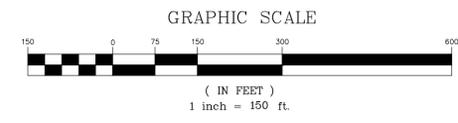

PROGRESS PLANS
1/11/18

P:\PROJECTS\17218\17218-01\17218-01.dwg 1/11/18 2:45:04 PM